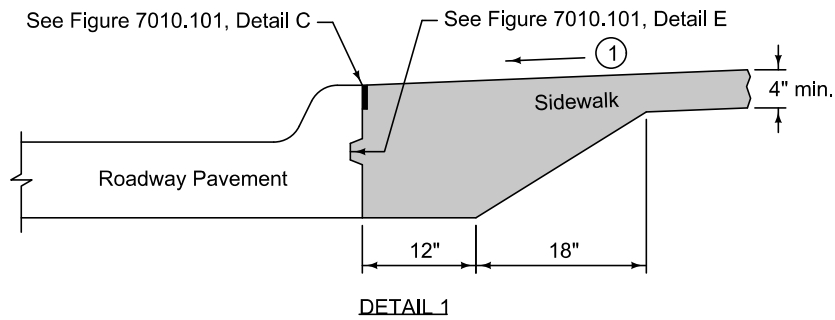


For new sidewalk with new curb and gutter, comply with Detail 1 or Detail 2. Comply with Detail 3 for new sidewalk adjacent to existing pavement or when specified in the contract documents.

- ① Target cross slope of 1.5% with a maximum cross slope of 2.0%.

|                                                                                       |              |          |
|---------------------------------------------------------------------------------------|--------------|----------|
|  | REVISION     |          |
|                                                                                       | 3            | 10-20-15 |
|                                                                                       | 7030.202     |          |
|                                                                                       | SHEET 1 of 1 |          |
| SUDAS Standard Specifications                                                         |              |          |
| CURB DETAILS FOR<br>CLASS A SIDEWALK                                                  |              |          |